

ControlEdge RTU Specification Sheet



SC03-300-174

Release 174

December 2022, Version 1.0

Revision History

Revision	Date	Description
1.0	December, 2022	R174 release

Table of Contents

1. Introduction	5
1.1. ControlEdge RTU Overview	5
1.2. Document Scope	5
1.3. Definitions	6
2. Specifications	6
2.1. ControlEdge 2020 Controllers	6
2.1.1. Performance	7
2.1.2. Datalog Support	8
2.1.3. Communication Capabilities	8
2.1.4. Watchdog	13
2.2. ControlEdge 2020 I/O Modules	13
2.2.1. Analog Input Channel Parameters	13
2.2.2. Analog Output Channel Parameters	14
2.2.3. Digital Input Channel Parameters	15
2.2.4. Digital Output Channel Parameters	15
2.2.5. Pulse Input Channel Parameters	16
2.2.6. Scalability Parameters	16
2.2.7. End Plates	17
2.2.8. Expansion Cable	17
2.3. Foundation Fieldbus I/O	17
2.4. Wireless I/O	18
2.5. Electronic Flow Metering	19
2.6. Applications	20
2.7. Simulation	20
2.8. ControlEdge Builder	20
2.8.1. ControlEdge Builder Capabilities	20
2.8.2. Function Block Libraries	21
2.8.3. ControlEdge Builder Hardware Requirements	22
2.9. General	23
2.9.1. Power Requirements	23
2.9.2. Power Consumption	23
2.9.3. Physical and Environment	24
2.10. Standards and Approvals	25
2.10.1. Hazardous Locations Approvals	25
2.10.2. CE Compliance Standards	27
2.10.3. Marine Certification	28
2.10.4. Security Certification	28
2.10.5. Other Standards	28
3. Model Numbers	28
3.1. Hardware	28
3.1.1. ControlEdge 2020 Platform	29
3.1.2. Series C Foundation Fieldbus Module	29
3.2. Software Licenses	29
3.2.1. Controller Resident	29

3.2.2. Configuration Tool Resident30

1. Introduction

This document provides technical information for ControlEdge™ RTU. Further product descriptions can be found in the Product Information Note. Detailed planning, installation and configuration information is available in the product user guides.

1.1. ControlEdge RTU Overview

ControlEdge RTU is a modular, powerful and scalable process controller capable of all remote automation and control applications. It is designed to communicate with any SCADA system but when combined with Experion® PKS and its radically simplified SCADA configuration with superior operator experience, it solves the most challenging remote automation requirements.

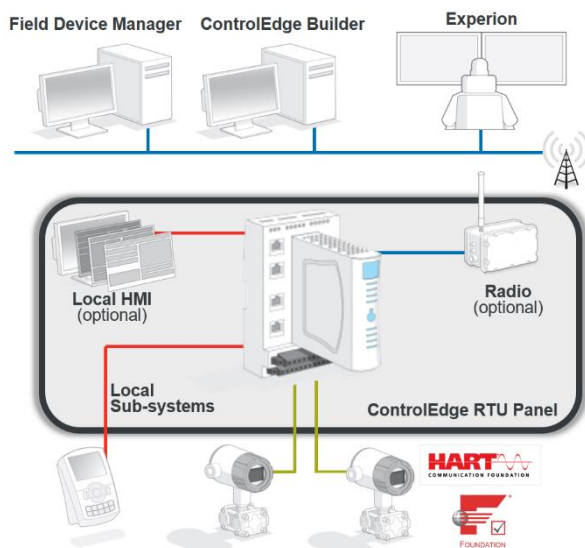


Figure 1 – Sample RTU System Architecture

Key features of ControlEdge RTU include:

- Lowest power consumption in its category at a typical 1.9W
- Temperature range -40 to 75°C (-40 to 167°F) with ControlEdge 2020 Platform. Up to 75°C, not 70°C like other units
- High reliability with well-designed thermal paths
- HART enabled onboard I/O. No extra hardware required. Digital HART data & diagnostics are available locally for use in RTU program and remotely via HART-IP
- HART-IP allowing remote asset management of HART devices via Honeywell's Field Device Manager
- Foundation Fieldbus I/O with Series C FIM4
- Wireless I/O with Field Device Access Point (FDAP)
- Efficient wiring and configuration saving installation and maintenance time
- Modern, powerful CPU
- Transient Suppression on every I/O channel and every communication port
- A powerful IEC 61131-3 programming environment
- Liquids and gas calculations in the same controller
- Flexible communication options
- Industry standard protocols of Modbus & DNP3
- ISASecure Level 2 certification

1.2. Document Scope

This document provides specifications for the following components:

ControlEdge 2020 Platform Controllers and I/O Modules

Wireless I/O

Foundation Fieldbus I/O

EFM I/O

ControlEdge Builder

1.3. Definitions

- **IOTA, Input Output Termination Assembly:** An assembly that holds the IOM and the connections for field wiring. The IOTA contains only passive devices.
- **IOM, Input Output Module:** A device that contains most of the electronics required to perform a specific I/O function. The IOM plugs onto the IOTA.
- **CPM, Control Processor Module:** A device that contains most of the electronics required to perform the function of a process controller. A CPM plugs onto an IOTA designed for the CPM. The CPM may optionally include the functionality of an IOM.
- **EFM, Electronic Flow Meter:** Used for highly accurate custody transfer metering.

2. Specifications

2.1. ControlEdge 2020 Controllers

ControlEdge RTU has an innovative modular hardware design with processor modules that plug onto IOTAs that contain only passive devices such as cable connectors and an expansion I/O connector allowing expansion I/O modules to connect without any further infrastructure.

Non-Redundant Controller

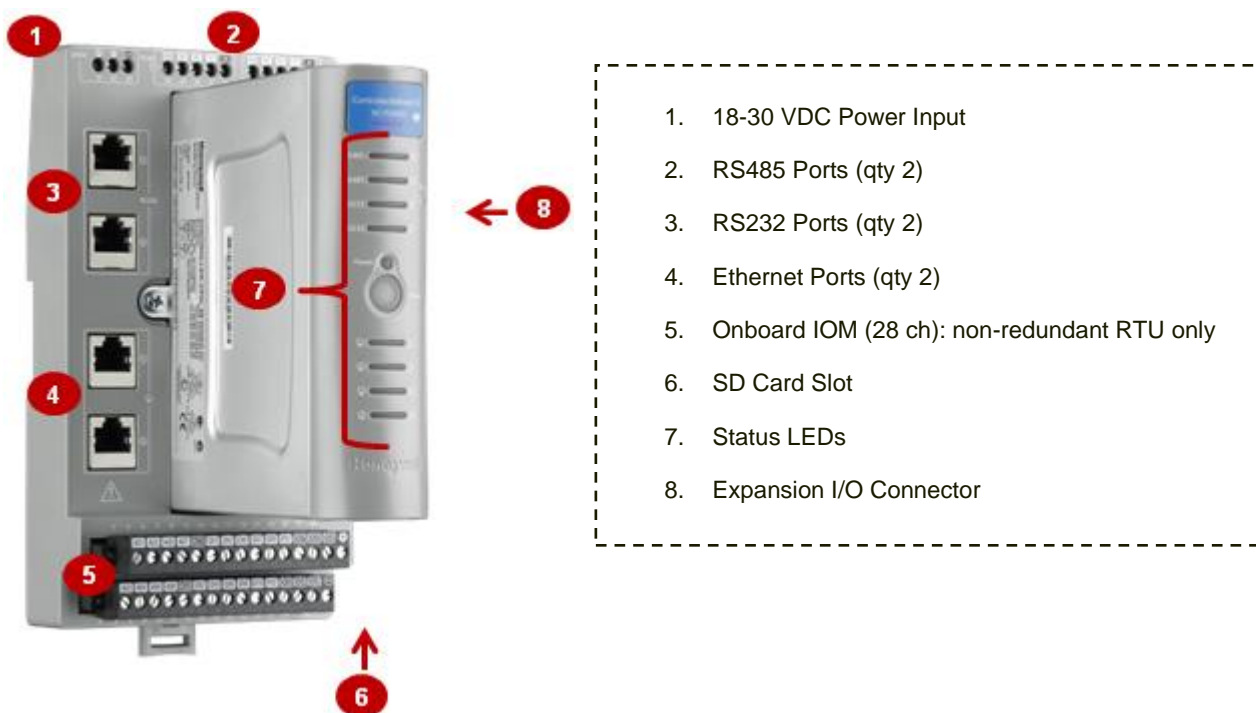
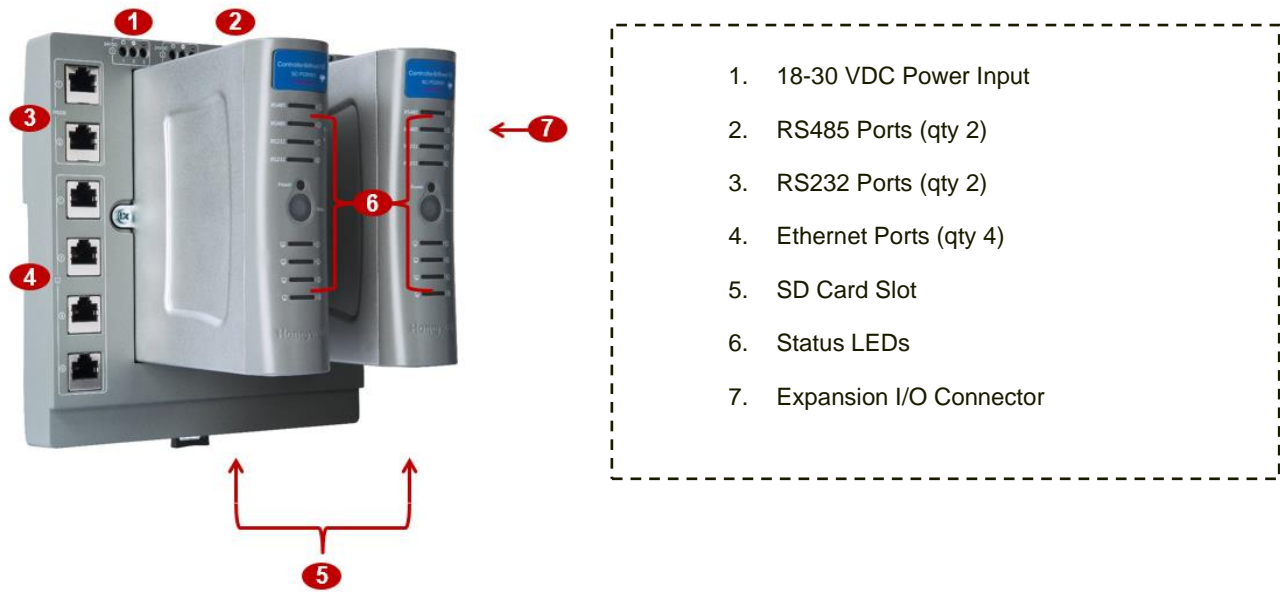


Figure 2 – Non Redundant Controller Hardware Summary

Redundant Controller**Figure 3 –Redundant Controller Hardware Summary****2.1.1. Performance**

Item	Specification
Processor	Dual Core ARM® Cortex™-A9 Core (32 bit) 667 MHz Non-Redundant and Redundant Controller
Dynamic memory (RAM)	256 MB, Non-Redundant Controller 512 MB, Redundant Controller
Program memory (Flash)	256 MB, Non-Redundant Controller 256 MB, Redundant Controller
Nonvolatile memory	4Mbits, Non-Redundant Controller 16Mbits, Redundant Controller
Nonvolatile memory data life	20+ years, no battery required
Real-time clock resolution	1 ms
Execution cycle time	>= 20 ms
Time Synchronization	Simple Network Time Protocol (SNTP) or DNP3
Programming port	Ethernet port

Item	Specification
Power supply port	1, Non-Redundant Controller 2, Redundant Controller
SD card support	32GB Class 6 / Class 10 industry standard

2.1.2. Datalog Support

Item	Specification
Datalog Media	Flash memory or optional SD Card
Datalog rate	Configurable: 1 second, 5 seconds, 10 seconds, 1 minute, 5 minutes, 10 minutes and 1 hour
Datalog Timestamp resolution	1 ms

2.1.3. Communication Capabilities

RTUs need to efficiently manage unreliable, low bandwidth networks. They need to communicate as a responder device to a remote SCADA system, often over a redundant link on two different mediums, but also as a requestor to local subsystems like gas chromatographs and smart drives. ControlEdge RTU covers all the scenarios by supporting SCADA protocols such as Modbus and DNP3.

Ethernet

Item	Specification
Number of ports	2, ANSI/IEEE 802.3 Non-Redundant Controller 4, ANSI/IEEE 802.3 (Redundant Controller, 2 x CPM)
Independent networks	Can be on same or different Subnets
Network connection	shielded RJ45 connector, auto-crossover
Network port speed	10/100BaseTx, auto-detecting
Isolation	1500 Volts RMS 1 minute, 60 Hz
Transient Voltage Suppression	600W peak pulse power capability at 10×1000µs waveform, repetition rate:0.01%
Message response time (typical)	100ms
Diagnostic LEDs on each port	Yes
Concurrent connections	64

Item	Specification
Distance supported	100m
Protocols	TCP/IP, ARP, UDP, ICMP, DHCP, Modbus TCP, Enron Modbus, DNP3 TCP, HART-IP, MQTT, IEC60870

Serial

Item	Specification
Number of Ports	2 x RS232 ports and 2 x RS485 ports
Baud rate supported	300, 600, 1200, 2400, 4800, 9600, 19200, 38400, 57600, 115200
RS232 Port 1 and 2	RJ45 (TD, RD, CTS, RTS, CD, DTR, DSR/RI, GND), full duplex
RS232 distance	15m
RS485 Port 1 and 2	Screw terminals (GND, 485+, 485-, termination, chassis), 2-wire half-duplex
Maximum number of responders connected to RS485 network	32
RS485 distance	1200m
RS485 termination	120ohm
Protocols	Modbus RTU Requestor, Modbus RTU Responder, Modbus ASCII Requestor, Modbus ASCII Responder, Enron Modbus Responder, User Defined Protocol
Diagnostic LEDs on each port	Transmit Data (Tx) & Receive Data (Rx)
Transient Voltage Suppression	600W peak pulse power capability at 10×1000µs waveform, repetition rate:0.01%

DNP3 Protocol

Item	Specification
Device Function	Master and Outstation
Protocol Compliance Level ¹	Level 3+
Capacity of events buffered	Flash memory: 200,000 events or Optional SD Card: 500,000 events
Maximum connections from Masters	5 Masters per Ethernet port

Item	Specification
Maximum connections to Outstations	10 Outstations across all Ethernet ports
Variable Capacity	6000
Report by Exception Capability	Yes
Ethernet support	Configurable TCP port number - default 20000
Serial support	No
Check Before Operate (CBO) support	Yes
DNP3 Secure Authentication	Version 5
Note 1 – See ControlEdge RTU DNP Device Profile Document (DPD) for complete details	

IEC60870-5 Protocol

Item	Specification
Device Function	Outstation
Maximum connections from Masters	5 Masters per Ethernet port
Variable Capacity	2000
Data update modes	General Interrogation, Spontaneous, Cyclic
Events Capacity	50k on Flash or 150k on SD Card
IEC60870-5-101	No
IEC60870-5-104	Yes

Modbus Protocol

Item	Specification
Device Function	Requestor and Responder
Multi-Requestor support	Yes
Register Capacity	16000

Item	Specification
Ethernet support	Modbus TCP (Requestor). Modbus TCP / UDP (Responder). Configurable TCP port number - default 502
Serial support	Modbus RTU or ASCII (Requestor/Responder)

Enron Modbus Protocol

Item	Specification
Device Function	Responder
Ethernet support	Enron Modbus TCP, Configurable TCP port number - default 503
Serial support	Enron Modbus RTU or ASCII

MQTT / Sparkplug Protocol

Item	Specification
Device Function	Edge of Network (EoN) Node, OASIS MQTT V3.1.1 compliant client
MQTT Payload	Sparkplug B
Maximum MQTT broker connections	1 active server across all Ethernet ports (while 2 can be configured)
MQTT Server support	OASIS MQTT V3.1.1 compliant servers
Variable Capacity	2000
Data publish modes	Periodic or Event
Ethernet support	Configurable TCP port number - default 1883. When TLS is enabled, port 8883 is recommended as default.
MQTT Quality of Service (QoS) levels supported	0: At most once delivery (0) 1: At least once delivery (1) 2: Exactly once delivery (2)
Secured communications	TLS
Serial support	No
Data store and forward	Supported

Item	Specification

User Defined Protocol

Item	Specification
Device Function	Requestor / Responder
Ethernet support	No
Serial support	Yes

Communication Security

Item	Supported Secure Communications Technology
Controller Configuration Protocol	IPsec
DNP3 Master/Outstation	IPsec
Modbus Requestor/Responder	IPsec
Enron Modbus Responder	IPsec
MQTT	TLS
HART-IP	IPsec
Certificate Authority	HTTP
IPsec Configuration App	TLS

HART-IP Protocol

Used by Honeywell's Field Device Manager for instrument asset management of ControlEdge RTU connected HART devices.

Item	Specification
Device Function	Read system capacity of RTU Read RTU and HART devices identity information HART command pass through to the connected HART devices HART delayed response mechanism to maximize system performance

Item	Specification
Ethernet support	HART-IP protocol, Version 7, based on TCP/IP Configurable TCP port number, default 5094 Support single Honeywell Field Device Manager connection
Serial support	No

2.1.4. Watchdog

Item	Specification
CPU watchdog	CPU automatically resets if error is detected; status LED flashes error code

2.2. ControlEdge 2020 I/O Modules

2020 I/O Modules come in two forms: onboard I/O and expansion I/O.



Both the onboard I/O module and mixed I/O module have the following mix of I/O channels.

Analog Input (HART)	8
Analog Output (HART)	2
Digital Input	10
Digital Output	6
Pulse Input (High Speed) or Digital Input	2

Details of each type of I/O are listed in tables below.

2.2.1. Analog Input Channel Parameters

Item	Specification
Number of Channels	8
Standard Input Range	4~20mA or 1-5VDC, software configurable

Item	Specification
Input Type	Single end
Short circuit protection	Yes
Isolation	No
Transient Voltage Suppression	600W peak pulse power capability at 10×1000µs waveform, repetition rate:0.01%
A/D resolution	16bit
Full scale accuracy	± 0.1% at 25°C ±0.2% from -40°C to 75°C
Repeatability	+/-0.05%
Temperature Coefficient	0.005% per Deg C
Differential Non Linearity	< 1 L.S.B
Normal Mode Rejection Ratio (NMRR)	Greater than 49dB at 60Hz
Input impedance (voltage mode)	1Mohm
Max HART Multi-drop Connection	One device per channel
Supported Device Wiring	2 wire, 3 wire, 4 wire devices

2.2.2. Analog Output Channel Parameters

Item	Specification
Number of Channels	2
Output Range	4-20mA
Output Type	Source
D/A resolution	12bit
Full scale accuracy	± 0.2% at 25°C ± 0.3% from -40°C to 75°C
Repeatability	± 0.1% of full scale
Temperature Coefficient	0.01% per Deg C of FSD
Differential Non Linearity	< 1 L.S.B
Load resistance (@ 24 V)	50-600ohm

Item	Specification
Max HART Multi-drop Connection	One device per channel
Short circuit protection	Yes
Transient Voltage Suppression	600W peak pulse power capability at 10×1000μs waveform, repetition rate:0.01%

2.2.3. Digital Input Channel Parameters

Item	Specification
Number of Channels	10
Input type	Sink (dry contact)
Input Isolation	No
Transient Voltage Suppression	600W peak pulse power capability at 10×1000μs waveform, repetition rate:0.01%
Input Voltage range	24VDC, +/-10%, external power supply
Guaranteed ON voltage	12VDC
Guaranteed OFF voltage	4VDC
Short Circuit Protection	Yes

2.2.4. Digital Output Channel Parameters

Item	Specification
Number of Channels	6
Maximum Output Power	24 VDC, 80 mA load per channel, external power supply
Output Type	Sink (voltage free)
Isolation	No
Output voltage range	24 VDC, +/-10%
On-State Voltage	Max 1 VDC, load current @ 80mA max
Off-State Voltage	24 V, typical
Max. off state leakage	100uA
Short circuit protection	Yes

Item	Specification
Transient Voltage Suppression	600W peak pulse power capability at 10×1000μs waveform, repetition rate:0.01%
Typical on resistance	0.8 ohm

2.2.5. Pulse Input Channel Parameters

Item	Specification
Number of Channels	2
Input Isolation	No
Transient Voltage Suppression	600W peak pulse power capability at 10×1000μs waveform, repetition rate:0.01%
Input Type	Sink
Input Voltage range	5 ~10Volt peak to peak
Input frequency	0 to 10kHz
Input Impedance	97 kohm
Minimum high level single width	40us
Guaranteed ON voltage	4.5V
Guaranteed OFF voltage	1.5V
PI configuration	As pulse input or digital input
Accumulator rate	Accumulator and rate functions
Filter	Configurable
Short Circuit Protection	Yes

2.2.6. Scalability Parameters

Item	Specification
Max number of expansion I/O modules	Non-Redundant Controller: 30 Redundant Controller: 30
Max number of expansion I/O rows	5

Item	Specification
Max number of expansion I/O modules per row	9

2.2.7. End Plates

ControlEdge 2020 expansion I/O modules are connected to the controller through a ring redundancy network which is terminated at the end of a row with a right end plate and Ethernet cable. Additional rows can be added and start with a left end plate and end with a right end plate.




2.2.8. Expansion Cable

To add additional rows of ControlEdge 2020 expansion I/O modules, Ethernet cables are connected between the left and right end plates to complete a ring network. The table below provides specifications for this cable.

Item	Specification
Cable type	CAT-5 (Straight/Cross)
max cable length	100 meters

2.3. Foundation Fieldbus I/O

ControlEdge RTU supports Foundation Fieldbus I/O through the Series C Fieldbus Interface Module (FIM4).

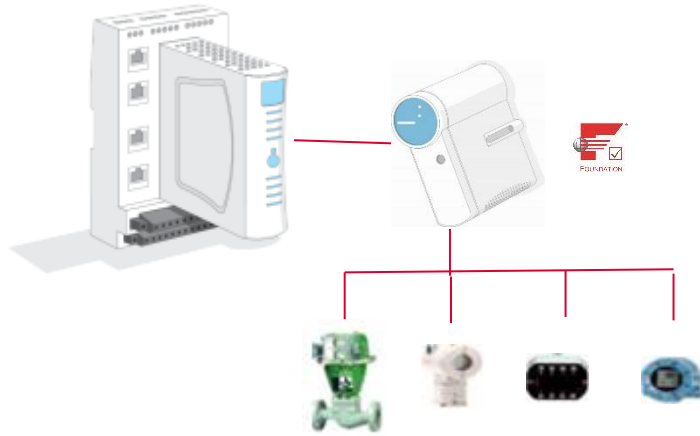


Item	Specification
Module type	Foundation Fieldbus
Maximum number of H1 networks	4
Maximum number of Fieldbus devices per H1 network	16
Operating Temperature	-40 to 70°C when FIM4 is used in the standard H1000xW800xD300 mm cabinet

Refer to the Honeywell Series C FIM4 specification sheet for further Fieldbus Interface module hardware specification. Honeywell Field Device Manager can be used to manage fieldbus devices connected to ControlEdge RTU.

2.4. Wireless I/O

ControlEdge RTU supports connecting ISA100 wireless devices to the controller via Honeywell Field Device Access Point (FDAP). FDAP is an ISA100.11a access device. These wireless devices appear as I/O to the controller. Wireless HART support is added where HART information from smart instruments can be accessed wirelessly.

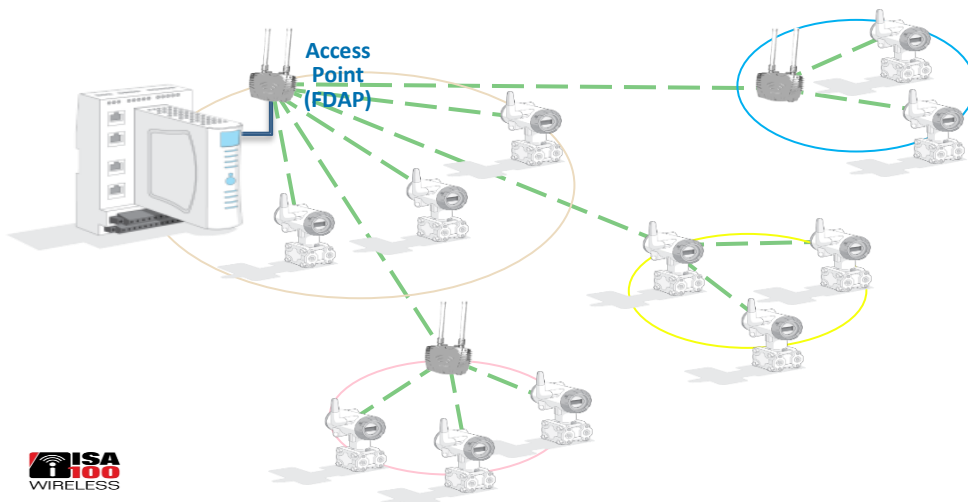

Item	Specification
Wireless device type	ISA100, WirelessHART
Maximum number of FDAP per controller	4
Maximum number of wireless devices per controller	25 for WirelessHART only; 25 for ISA100 only; 12 for WirelessHART and 12 for ISA100 when mixed .

Please refer Honeywell FDAP specification for FDAP hardware specification. Honeywell's Field Device Manager shall be used to manage FDAP, Wireless devices connected to ControlEdge RTU.

2.5. Electronic Flow Metering

In the oil & gas industry, Electronic Flow Metering (EFM) records and stores custody transfer information by accurately measuring and recording the energy transferred from one location to another location. ControlEdge RTU is designed to work as electronic flow metering device for gas and liquid.

Item	Specification
Standards	API MPMS 21.1(Gas) API MPMS 21.2(Liquid) AER Directive 17
Maximum number of meter runs	4 (Non redundant controller) 12 Redundant Controller
Protocol to extract data logs	Enron Modbus Responder (Serial / Ethernet) DNP3 (Ethernet)

Note: Both Gas and Liquid meter runs can be executed together at the same time.

2.6. Applications

Applications are ready to deploy, purpose built, control schemes. Users configure applications by completing a configuration wizard to set site specific parameters and I/O assignments.

Item	Specification
Supported Applications	<ul style="list-style-type: none"> Plunger Lift - artificial lift techniques used to extend well life and production capacity of wells. Supported modes: Intermittent; Monitor; Optimization.
Maximum number of applications	4 (Non redundant controller or redundant controller)

2.7. Simulation

Improve your project schedule by simulating the controller.

Item	Specification
Program Execution	Yes
Protocols	Modbus TCP – Client / Server, DNP3 – Outstation / Master, IEC 6087-5-104
Metering Calculations Library	yes
Meter Run	No
Note: Controller Simulation requires VMware Workstation Player 12.5.8 or high version <ul style="list-style-type: none"> VMware vCenter Server 6.0.0 or high version 	

2.8. ControlEdge Builder

ControlEdge Builder is configuration tool to design, configure, program and maintain your RTU investment.

2.8.1. ControlEdge Builder Capabilities

Item	Specification
IEC 61131-3 programming	Yes
Languages Supported	Ladder Diagram (LD) Function Block Diagram (FBD) Structured Text (ST) Instruction List (IL) Sequential Function Chart (SFC)

Item	Specification
Communication Medium to RTU	Ethernet
Bulk Replication of Program	Yes
Remote Download of Program	Yes
Remote Reboot	Cold or Warm Reboot
Remote Firmware Upgrade	Yes
Remote Diagnostics	Yes
Remote Data Log File Upload	Yes
Bulk Download	Download to same project to up to 100 controllers in sequence

2.8.2. Function Block Libraries

ControlEdge Builder provides a range of function block libraries.

Item	Specification
Function Block Libraries ¹	Standard IEC61131-3 Metering Calculation Honeywell Control HART Modbus DNP3 Unit Conversion Utility User Defined Protocol ELEPIU_MAX Energy Control Library
HART Library	HART Function Codes Supported: Command 03 Read Dynamic Variables and Loop Current Command 48 Read Additional Device Status Command X All HART Commands

Item	Specification
Metering Calculation Library	Gas
	AGA 3 (1992) Orifice Meter
	AGA3 (2012) Orifice Meter
	AGA 5 (2009) Volume to Energy Calculation
	AGA 7 (1996) Turbine Meter
	AGA 8 (1994) Gas Compressibility
	AGA8 (2017) Gas Compressibility
	AGA 9 (1996) Ultrasonic Meter
	AGA 11 (2013) Coriolis Meter
	ISO 6976 (1995) Natural gas: calorific value density, relative density and Wobbe Index
	Liquid
	API 11.1 (2004) Volume Correction Factor
	API 11.2.2/M (1986) Compressibility Factors
API 11.2.4 (2007) Temperature Correction	
API 11.2.5 (2007) Correction Factor for pressure	
Gas & Liquid	
ISO 5167 (1991, 1997, 2003) Pressure differential devices such as orifice plates and Venturis.	
AGA3 (2012) Orifice Meter	
Note 1 – See ControlEdge Builder Functions and Function Block Reference Guide (RTDOC-X286) Appendix for complete Function Block Library details	

2.8.3. ControlEdge Builder Hardware Requirements

Item	Specification
Typical Processor	Pentium or compatible processor (2 GHz) Recommended: Intel® Core™ i5 or equivalent better
RAM	Minimum: 1 GB Recommended: 4 GB
Hard Drive	5 GB available space
Communication Medium to RTU	Ethernet
Operating System	Windows 10, 32 bit or 64 bit Windows Server 2016 Standard Edition 64-bit
Display color settings	True color (32-bit)

Item	Specification
Resolution	Recommended resolution: 1280x800 or above Optimal resolutions: 1920x1080, 1366x768, 1280x1024 and 1280x800
Graphic Card	DirectX9 compatible graphic adapter
Installation Media	Via CD-ROM drive

2.9. General

2.9.1. Power Requirements

Power is supplied to the controller and I/O modules through the power input terminals on the controller IOTA and the left end plate, (when used). The relevant specifications at each power input terminals are detailed below.

Item	Model Number	SC-UCMX02	SC-UCNN11	SC-TEPL01
	Description	Non Redundant Controller with onboard IOM	Redundant Controller	Left End Plate
Rated input voltage		24 VDC \pm 25%	24 VDC \pm 25%	24 VDC \pm 25%
Input voltage range		18 to 30 VDC	18 to 30 VDC	18 to 30 VDC
Maximum ripple voltage		120 mVpp	120 mVpp	120 mVpp
Maximum rated input current		1.20 A at 30 VDC (controller plus 9 IOMs)	1.30 A at 30 VDC (Redundant controllers plus 9 IOMs)	1.02 A at 30 VDC (9 IOMs)

2.9.2. Power Consumption

The tables below are provided for the purpose of sizing power systems. Three different scenarios are provided with each having various controller options configured. Select the scenario most suited and interpolate values when required.

These tables only include power consumption data of the listed modules and do not include power consumption of any connected instruments, (transmitters, valves etc.), even if that power is provided through the I/O module terminals. Allow for instrument power consumption separately in your power system sizing calculations along with other components to be powered by the system, (e.g., network radio).

Model Number	Minimum Power Consumption where there are no expansion IOMs	Maximum Power Consumption where there are no expansion IOMs	Maximum Power Consumption where there are expansion IOMs
SC-UCMX02	1.7 W ²	2.9 W ³	3.4 W ⁴
SC-UCNN11	5.76 W ⁵	6.72 W ⁶	6.96 W ⁷

Model Number	Minimum Power Consumption where there are no expansion IOMs	Maximum Power Consumption where there are no expansion IOMs	Maximum Power Consumption where there are expansion IOMs
<p>Note 1 – All values exclude power consumption of any connected instruments.</p> <p>Note 2 – Input voltage 24Vdc; All I/O channels active; no serial ports active; Ethernet port 2 active; Ethernet ports 1 and 3 not active.</p> <p>Note 3 – Input voltage 24Vdc; All I/O channels active; 4 serial ports active; Ethernet ports 1 and 2 active; Ethernet port 3 not active.</p> <p>Note 4 – Input voltage 24Vdc; All I/O channels active; 4 serial ports active; Ethernet ports 1, 2 and 3 active; Does not include expansion IOMs.</p> <p>Note 5 – Input voltage 24Vdc; no serial ports active; Ethernet port 1 active; Ethernet ports 2, 3, 4 and 5 not active.</p> <p>Note 6 – Input voltage 24Vdc; 4 serial ports active; Ethernet ports 1, 2, 3 and 4 active; Ethernet port 5 not active.</p> <p>Note 7 – Input voltage 24Vdc; 4 serial ports active; Ethernet ports 1, 2, 3, 4 and 5 active; Does not include expansion IOMs.</p>			

Other hardware

Model Number	Specification
SC-UMIX01	2.0 W
SC-TEPR01	0.0 W
SC-TEPL01	0.0 W
<p>Note 1 – All values exclude power consumption of any connected instruments.</p> <p>Note 2 – Input voltage 24Vdc; All I/O channels active;</p>	

2.9.3. Physical and Environment

Dimensions and Weight

Model Number	Specification	
	Dimensions (mm) L x W x H	Weight (g)
SC-UCMX02	190 x 99 x141	700
SC-UCNN11	190 x170 x141	1000
SC-UMIX01	190 x 99 x141	680
SC-TEPR01	190 x 39 x 16	140
SC-TEPL01	190 x 39 x16	140

Other

Unless specified separately, all ControlEdge RTU hardware meets the following common specifications.

Item	Specification
Mounting	DIN rail (TH35-7.5)
Operating Temperature	-40 to 75°C (-40 to 85°C storage) -40 to 70°C when FIM4 (Foundation Fieldbus) is used in the standard H1000xW800xD300 mm cabinet
Humidity	5% to 95% RH (non-condensing)

2.10. Standards and Approvals

2.10.1. Hazardous Locations Approvals

Certification	Approval Rating														
CSA	Class I, Division 2, Group A, B, C, D; T4 Ex ec IIC T4 Gc Class I, Zone 2 AEx ec IIC T4 Gc AEx nA IIC T4 Gc														
ATEX	II 3 G Ex ec IIC T4 Gc														
IECEX	Ex ec IIC T4 Gc														
<p>Note 1 - Classification of maximum surface temperatures for Group II electrical equipment are:</p> <table> <thead> <tr> <th>Temperature class</th> <th>Maximum surface temperature °C</th> </tr> </thead> <tbody> <tr> <td>T1</td> <td>450</td> </tr> <tr> <td>T2</td> <td>300</td> </tr> <tr> <td>T3</td> <td>200</td> </tr> <tr> <td>T4</td> <td>135</td> </tr> <tr> <td>T5</td> <td>100</td> </tr> <tr> <td>T6</td> <td>85</td> </tr> </tbody> </table>		Temperature class	Maximum surface temperature °C	T1	450	T2	300	T3	200	T4	135	T5	100	T6	85
Temperature class	Maximum surface temperature °C														
T1	450														
T2	300														
T3	200														
T4	135														
T5	100														
T6	85														

UL Standards

Title	Number
Nonincendive electrical equipment for use in Class I and II, Division 2 and Class III, Division 1 and 2 hazardous (classified) locations	UL121201 (Ninth Edition)
Explosive atmospheres - Part 0: Equipment – General Requirements	UL 60079-0 (Sixth Edition)
Explosive atmospheres - Part 7: Equipment protection by increased safety "e"	UL 60079-7- 2017

Title	Number
Safety Requirements for Electrical Equipment for Measurement, Control, and Laboratory Use - Part 1: General Requirements	UL Std. No. 61010-1 (3rd Edition)

CSA Standards

Title	Number
Nonincendive electrical equipment for use in Class I and II, Division 2 and Class III, Division 1 and 2 hazardous (classified) locations	CAN/CSA-C22.2 No. 213 - 17
Safety Requirements for Electrical Equipment for Measurement, Control, and Laboratory Use, Part 1: General Requirements	CAN/CSA-C22.2 No. 61010-1-12
Explosive atmospheres - Part 0: Equipment - General requirements	CAN/CSA-C22.2 No. 60079-0:15
Explosive atmospheres - Part 7: Equipment protection by increased safety "e"	CAN/CSA-C22.2 No. 60079-7:16
General Requirements - Canadian Electrical Code Part II	CAN/CSA C22.2 No. 0-10 (R2015)

ATEX/UKCA Standards

Title	Number
Electrical apparatus for explosive gas atmospheres. Part 0: General Requirements	EN IEC60079-0: 2018
Explosive atmospheres - Part 7: Equipment protection by increased safety "e".	EN 60079-7:2015+A1:2018

IEC Standards

Title	Number
Electrical apparatus for explosive gas atmospheres. Part 0: General Requirements	IEC 60079-0 (2017)
Explosive atmospheres - Part 7: Equipment protection by increased safety "e".	IEC 60079-7:2017 Ed 5.1

2.10.2. CE Compliance Standards

Low Voltage Directive (LVD)

Title	Number	Issue Date
Safety requirements for electrical equipment for measurement, control, and laboratory use – Part 1: General requirements	EN 61010-1	2010

Electromagnetic Compatibility (EMC) Directive

Title	Number	Issue Date
Electrical equipment for measurement, control and laboratory use - EMC requirements -- Part 1: General requirements	EN 61326-1	2013
Industrial, scientific and medical (ISM) radio-frequency equipment – Electromagnetic disturbance characteristics – Limits and methods of measurement.	CISPR 11: 2009+A1	2010
Electromagnetic compatibility (EMC) – Part 3-2: Limits – Limits for harmonic current emissions (equipment input current \leq 16A per phase)	IEC 61000-3-2	2009
Electromagnetic compatibility (EMC) – Part 3-3: Limits – Limitation of voltage changes, voltage fluctuations and flicker in public low-voltage supply systems, for equipment with rated current \leq 16 A per phase and not subject to conditional connection	IEC 61000-3-3	2005
Electromagnetic compatibility (EMC) – Part 4-2: Testing and measurement techniques – Electrostatic discharge immunity test	IEC 61000-4-2	2008
Electromagnetic compatibility (EMC) – Part 4-3: Testing and measurement techniques – Radiated, radio-frequency, electromagnetic field immunity test	IEC 61000-4-3: 2006+A1:2007+A2	2010
Electromagnetic compatibility (EMC) – Part 4-4: Testing and measurement techniques – Electrical fast transient/burst immunity test	IEC 61000-4-4: 2004+A1	2010
Electromagnetic compatibility (EMC) – Part 4-5: Testing and measurement techniques – Surge immunity test	IEC 61000-4-5	2005
Electromagnetic compatibility (EMC) – Part 4-6: Testing and measurement techniques – Immunity to conducted disturbances, induced by radio-frequency fields	IEC 61000-4-6	2008
Electromagnetic compatibility (EMC) – Part 4-8: Testing and measurement techniques – Power frequency magnetic field immunity test	IEC 61000-4-8	2009
Electromagnetic compatibility (EMC) – Part 4-11: Testing and measurement techniques – Voltage dips, short interruptions and voltage variations immunity tests	IEC 61000-4-11	2004

2.10.3. Marine Certification

Certification	Approval Rating
BV	Bureau Veritas Rules for the Classification of Steel Ships (EC Code: 31) ¹
DNVGL	DNV GL Rules for classification of +/- Ships, Offshore units, and high speed and light craft
Note 1 - Approval valid for ships intended to be granted with the following additional class notations: AUT-UMS, AUT-CCS, AUT-PORT and AUT-IMS.	

2.10.4. Security Certification

Item	Specification
ISASecure, IEC 62443 Conformance	SC-UCMX02, firmware version R160: Security Level 2; SC-UCNN11, firmware version R150: Security Level 2;

2.10.5. Other Standards

Item	Specification
Flammability	UL 94 V-0
EMC	RCM Mark
Conformal Coating	ANSI/ISA S71.04 Class G3
Vibration	IEC 60068-2-6: 1.0 g acceleration over 10–150 Hz; 0.5 g acceleration over 150–2000 Hz

3. Model Numbers

3.1. Hardware

To simplify the ordering process, ControlEdge RTU has a limited number of model numbers to provide complete RTUs. For example, for one complete non-redundant Controller with Onboard Mixed I/O Module, only 1 model number is required, SC-UCMX02.

3.1.1. ControlEdge 2020 Platform

Model Number	Description
SC-UCMX02 ¹	Non-redundant Controller with 28 mixed onboard I/O with 256MB DRAM
SC-UCNN11 ²	Redundant Controller
SC-UMIX01 ³	Mixed I/O Module, 28 channels
SC-TEPR01	Expansion End Plate, Right
SC-TEPL01	Expansion End Plate, Left
Note 1 – Includes a complete Controller: CPM and IOTA Note 2 – Includes a complete Controller: 2 x CPM and 1 x IOTA Note 3 – Includes a complete IOM: IOM and IOTA	

3.1.2. Series C Foundation Fieldbus Module

Model Number	Description
CC-PFB402	Series C Foundation Fieldbus Interface Module with 4 H1 Links (FIM4)
CC-TFB402	Series C FIM4 IOTA, Non-redundant, 4 Links, coated

3.2. Software Licenses

3.2.1. Controller Resident

Model Number	Description
SP-IHARTP ¹	HART Protocol Enabler License
SP-MRUN01 ²	Meter Run License, one (1)
SP-IWIO01 ³	Wireless I/O License
SP-LEPIU1 ⁴	ELEPIU License per controller
Note 1 – HART enabler license required for each I/O module (onboard or expansion) where HART digital access is required Note 2 – Required per meter run per RTU for electronic flow meter functionality. Maximum meter runs supported per non redundant controller is 4 and redundant controller is 12. If an RTU has 4 meter runs then 4 x SP-MRUN01 are required. Note3 - Wireless I/O license is required for each controller where ISA100 devices need to be connected and accessed. Note 4 - ELEPIU license is required per controller using ELEPIU solution.	

3.2.2. Configuration Tool Resident

Model Number	Description
SP-EBLDR1 ¹	ControlEdge Builder, client license
SP-MCALC1 ²	Metering Calculation Library, site license
<p>Note 1 – One required for each computer (physical or virtual) ControlEdge Builder is to be installed on. Can run both online and offline.</p> <p>Note 2 – One required per site. The library can be used with all instances of ControlEdge Builder on the same site.</p>	

For more information

To learn more about Honeywell's products or solutions visit our website process.honeywell.com or contact your Honeywell account manager.

Honeywell Process Solutions

2101 CityWest Blvd,
Houston, TX 77042, USA

Honeywell House, Arlington Business Park,
Bracknell, Berkshire, England RG12 1EB UK

1EB Shanghai City Centre, 100 Junyi Road
Shanghai, China 20051

process.honeywell.com

Experion® and ControlEdge™ are trademarks of Honeywell International Inc.

All other products and brand names shown are trademarks of their respective owners.

This document contains Honeywell proprietary information. It is published for the sole usage of Honeywell Process Solutions' customers and prospective customers worldwide. Information contained herein is to be used solely for the purpose submitted, and no part of this document or its contents shall be reproduced, published, or disclosed to a third party without the express permission of Honeywell International Inc.

While this information is presented in good faith and believed to be accurate, Honeywell disclaims the implied warranties of merchantability and fitness for a particular purpose and makes no express warranties except as may be stated in its written agreement with and for its customer.

In no event is Honeywell liable to anyone for any indirect, special or consequential damages. The information and specifications in this document are subject to change without notice.

SC03-300-174
December 2022
© 2023 Honeywell International Inc.

The Honeywell logo is displayed in a bold, red, sans-serif font.